

FIG. 1

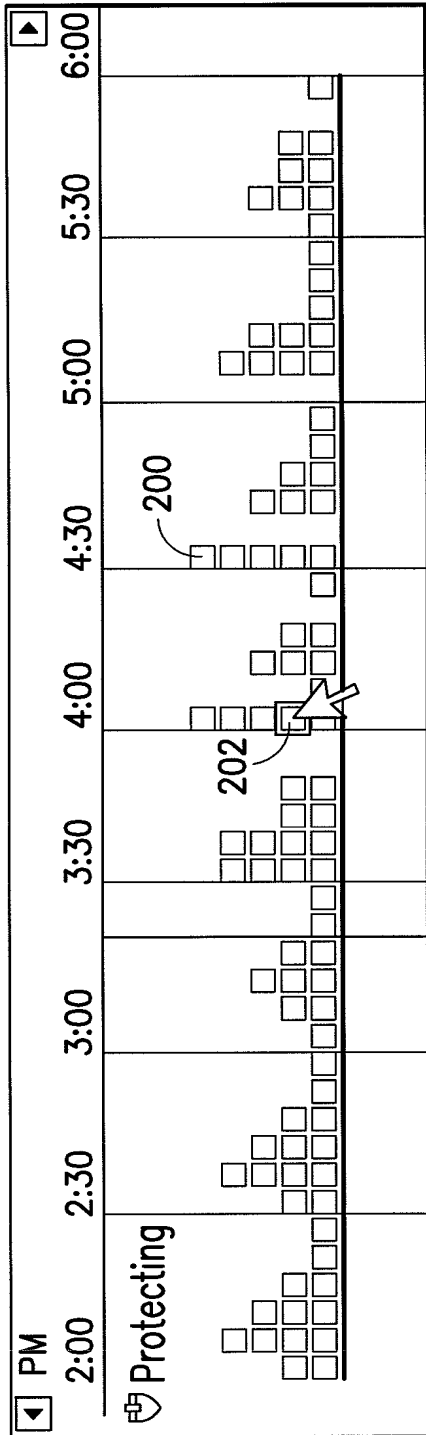


FIG. 2A

Event Log: Protecting

<

FIG. 2B



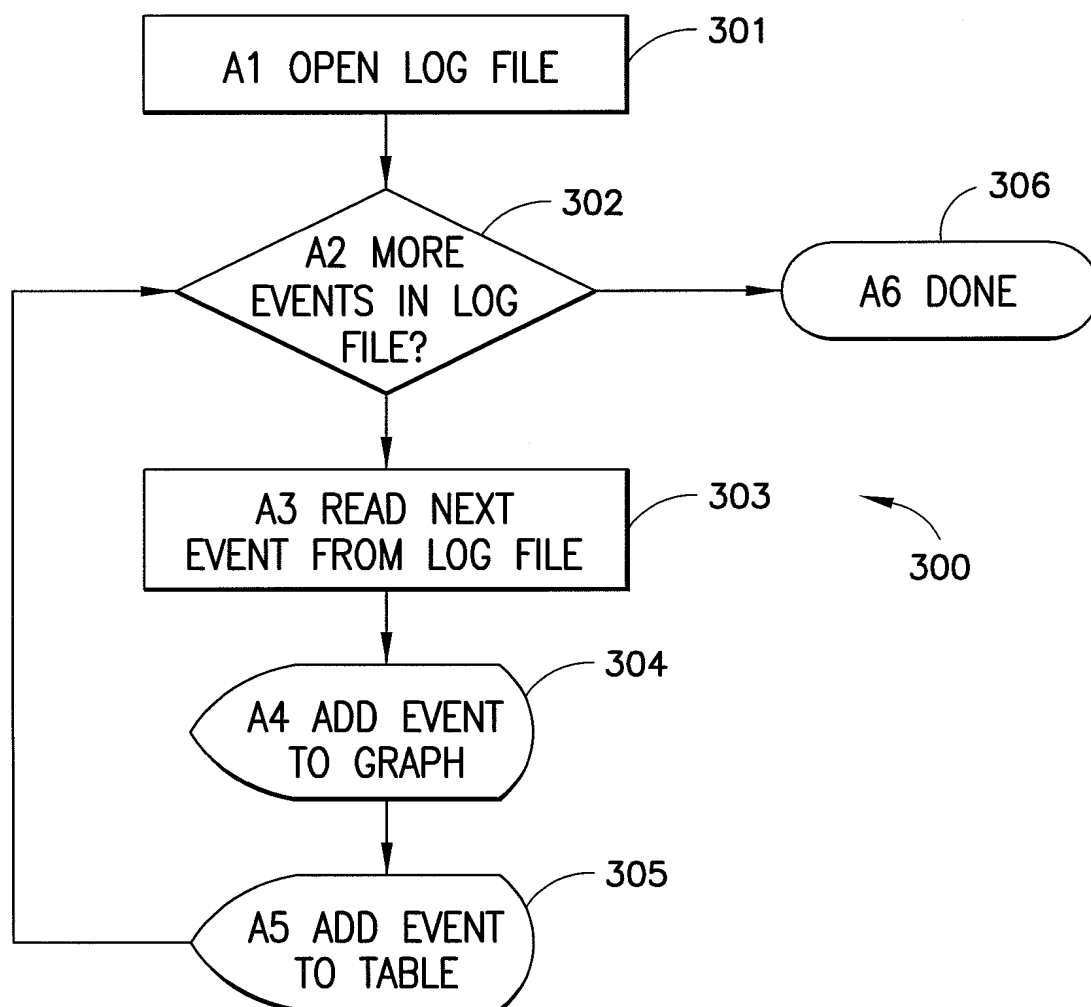



FIG.3

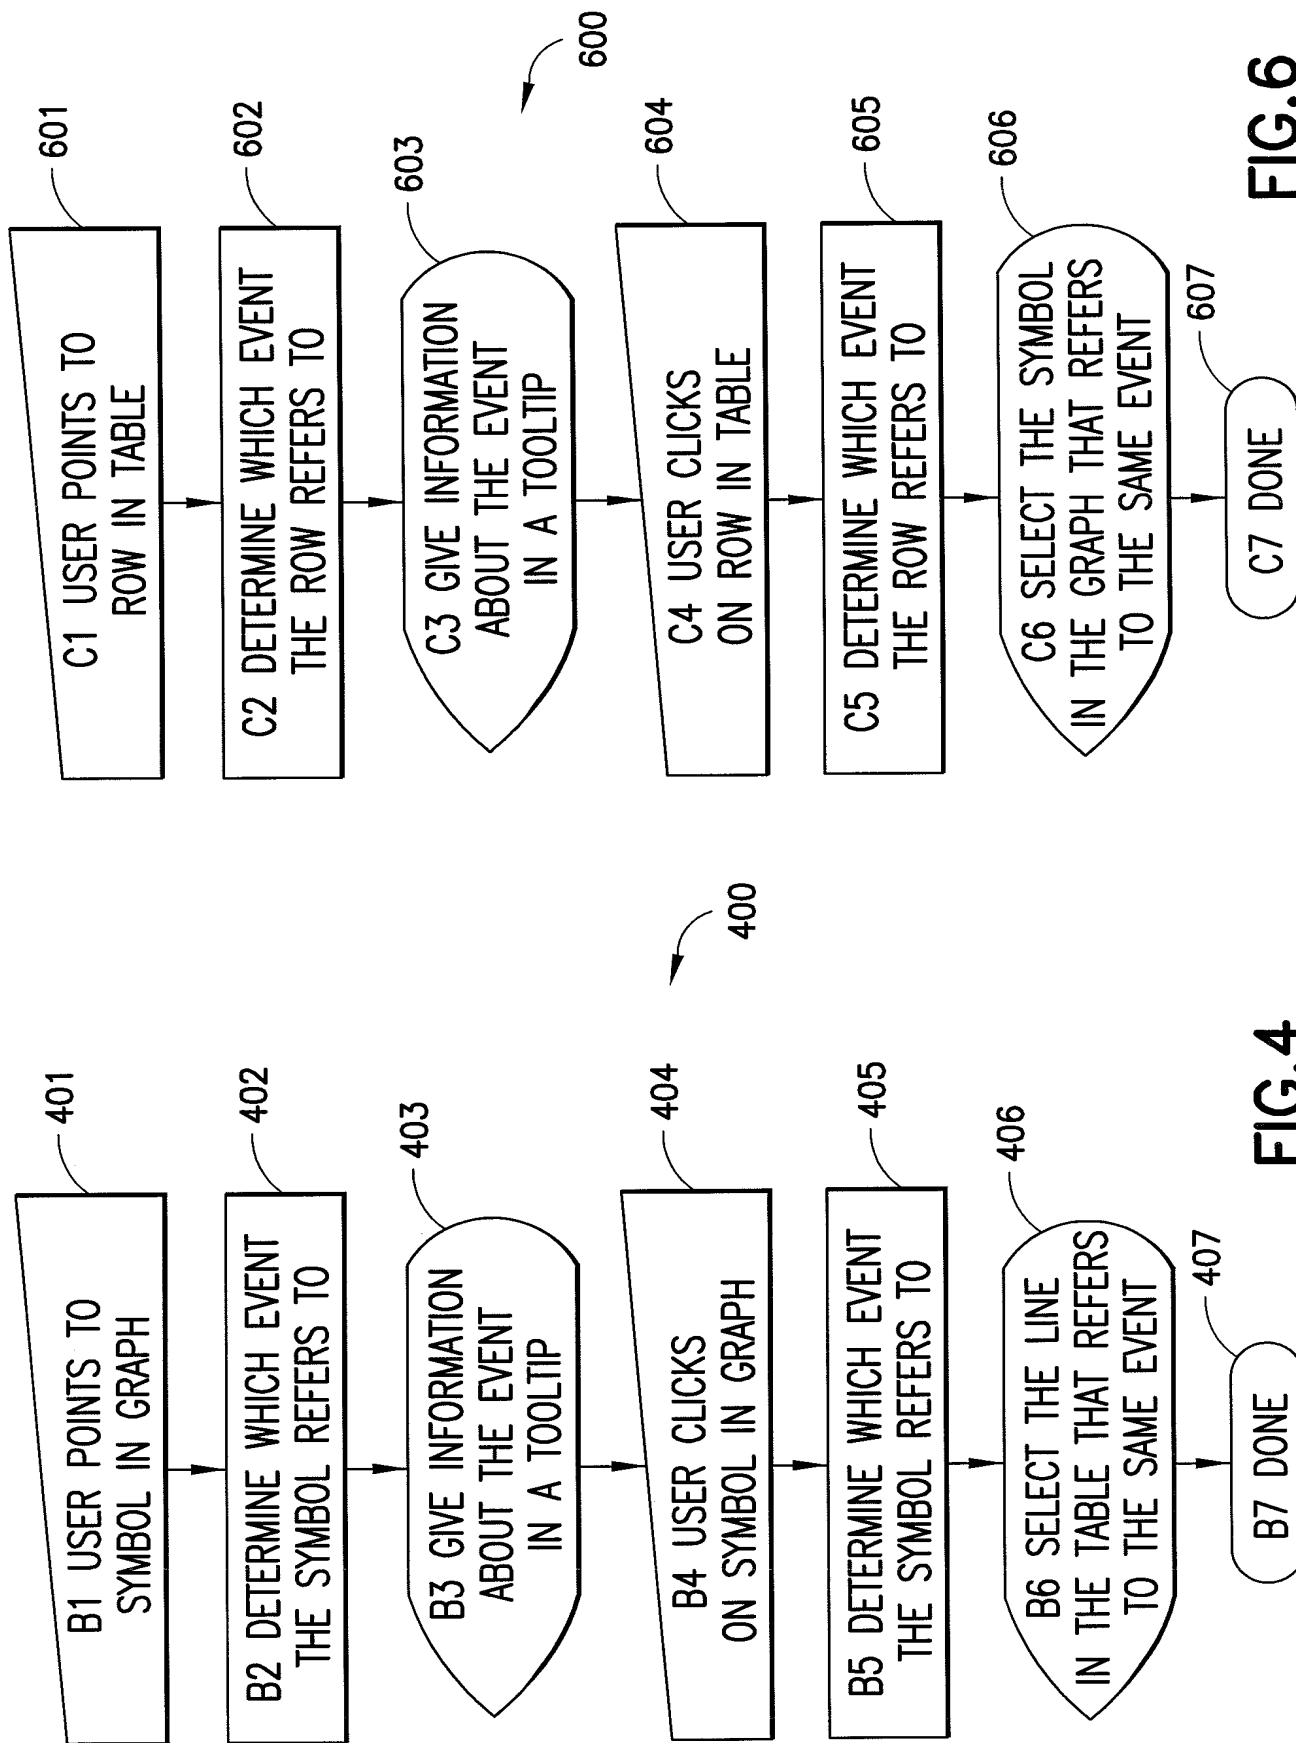

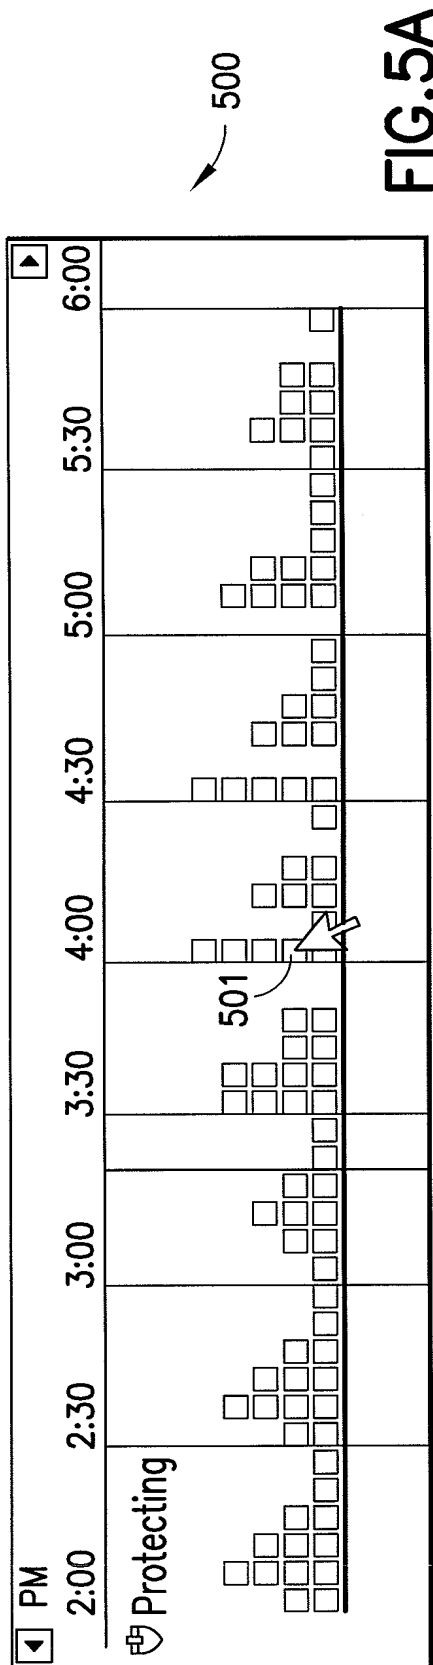

Event Log: Protecting

FIG. 5B

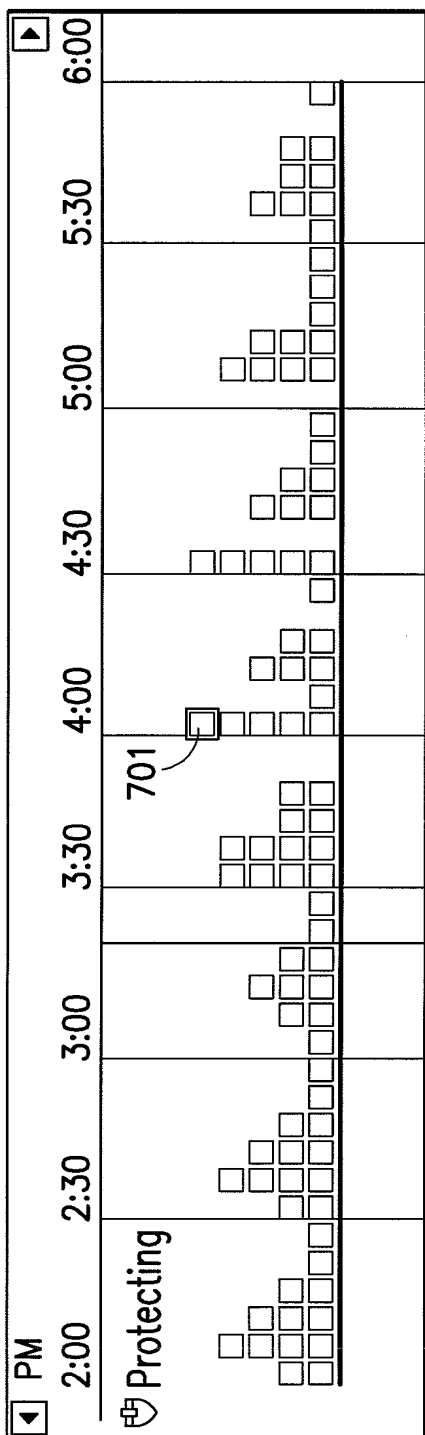








Event Log: Protecting				
	Name	Date and Time	Description	
	VetTank01	6/18/2003 4:01:20 AM	Drain pool STPool034 on Tank01 to Tank11	
	ESS01	6/18/2003 4:04:01 AM	Temperature threshold reached. Call home	
	DB2	6/18/2003 4:02:52 PM	Create STPool032 on Tank11	
	VetTank01	6/18/2003 4:02:10 PM	Code update completed	
	DB2	6/18/2003 4:04:12 PM	Code update initiated	
 Page 1 of 5  <input type="text"/> <input type="button" value="Go"/>				

FIG. 7B


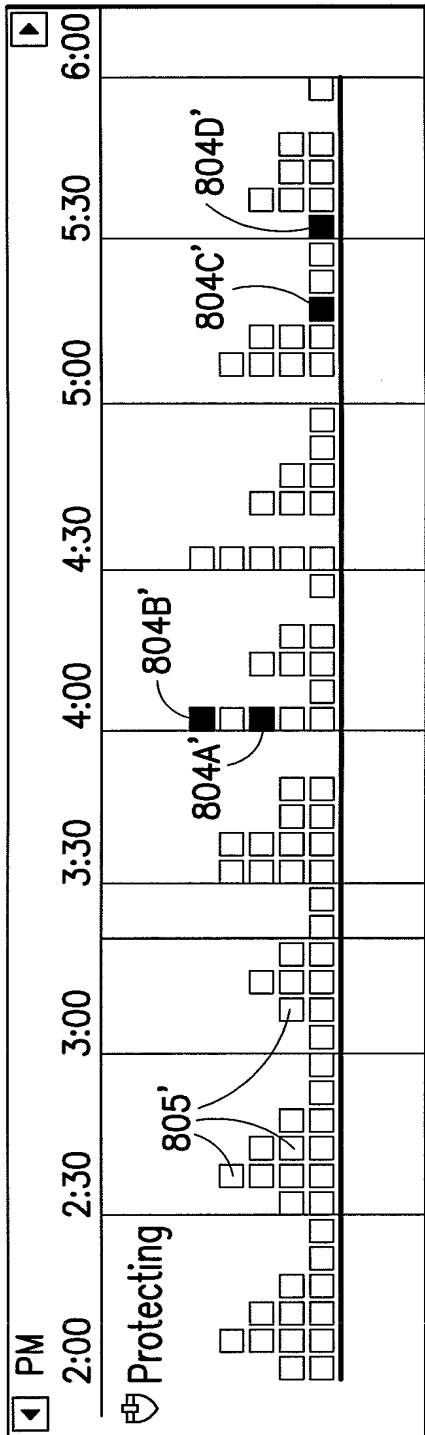


FIG. 8A

Event Log: Protecting

Name	Date and Time	Description
VetTank01	6/18/2003 4:01:20 AM	Drain pool STPool034 on Tank01 to Tank11
DB2	6/18/2003 4:02:52 PM	Create STPool032 on Tank11
VetTank01	6/18/2003 5:17:34 PM	pool STPool034 at 80% Capacity
VetTank01	6/18/2003 5:31:01 PM	pool STPool034 at 90% Capacity
Page 1 of 1		Total: 4 of 90 Filtered in

FIG. 8B

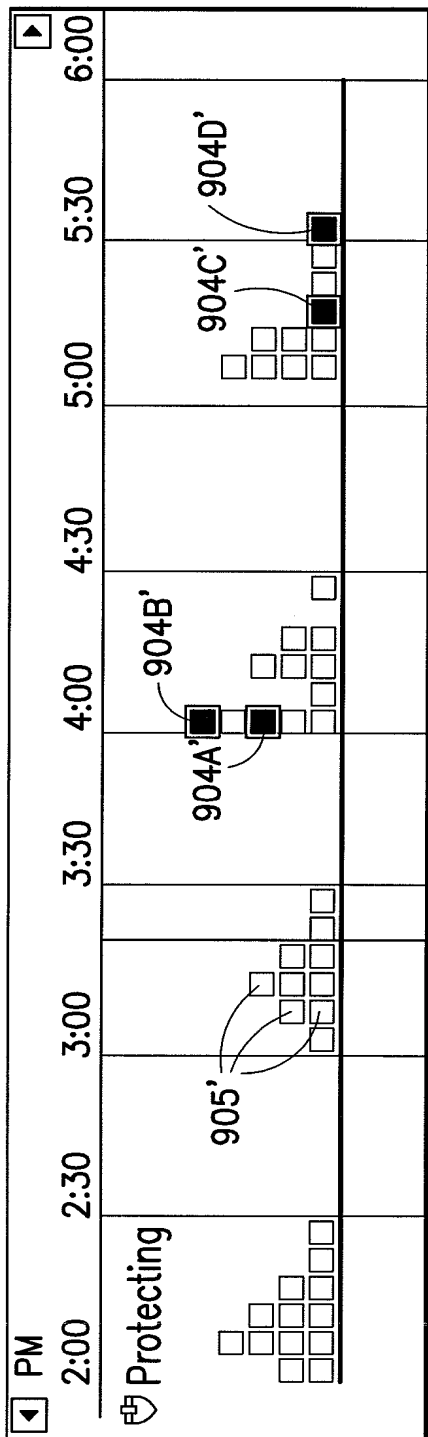

901 Event Log: Protecting

Name	Date and Time	Description
VetTank01	6/18/2003 4:01:20 AM	Drain pool STPool034 on Tank01 to Tank11
DB2	6/18/2003 4:02:52 PM	Create STPool032 on Tank11
VetTank01	6/18/2003 5:17:34 PM	pool STPool034 at 80% Capacity
VetTank01	6/18/2003 5:31:01 PM	pool STPool034 at 90% Capacity
Page 1 of 1		Total: 4 of 90 Filtered in

903 pool

904A

904B

904C

904D

905

FIG. 9B